



TECHNICAL UNIVERSITY OF CLUJ-NAPOCA

ACTA TECHNICA NAPOCENSIS

Series: Applied Mathematics and Mechanics

Vol. 55, Issue I, 2012

## EXPERIMENTAL RESEARCH REGARDING THE APPLICATION OF THE PREDICTIVE MAINTENANCE PROCEDURE WITHIN PAPER INDUSTRY

Ancuta PACURAR, Csaba GYENGE, Annamaria RAFA

**Abstract:** This paper presents applicative studies related to the implementation of the supervisor system and predictive maintenance in the paper industry. After analyzing the predictive maintenance concept are presented using a case study the advantages of the predictive maintenance concept. The paper present the application of the predictive maintenance concept, at S.C. SOMES Dej Company for the black lye pump of regeneration boiler used in the paper industry. By analyzing the possible defect causes of the equipment it was elaborated a repair procedure, which follows the predictive maintenance methodology. In order to find out what are the damages of the equipment a vibration detector was used in order to collect the data. Analyzing the collected data some solutions has been proposed in order to avoid the possible damages.

**Key words:** predictive maintenance, paper industry.

### 1. INTRODUCTION

The industrial development of the last decades – globalization, the increasing concurrency and the high qualitative claim requirements – has made the role of maintenance to be a very important issue. It is very well known that the industrial installations are in a continuous way exposed to a very complex degradation (erosion processes of wears), which leads after a period to severe break down of the equipment and the abruption of the entire manufacturing process.

These critical abruptions are less and less accepted by the industry because they could cause accidents, production-looses and important financial losses, too.

In order to increase the durability and to improve the functionality of the pumps from the paper manufacturing equipment the assurance of a correct exploitation and service based on the predictive maintenance methodology is compulsory needed [4].

According to the statistics, currently in the hard industry field of the petrol refinement, metallurgy, metallurgy of iron, the paper and pulp industry, the costs of the maintenance of

the equipments reach almost 40 % of the total manufacturing costs [2].

The repairs are made usually during the interruptions without being assured an optimal durability of the pumps.

The made repairs leads to technological lines braked-down and productivity loses [6]. When speaking about the classical maintenance, the investigations are made at least one time per year, when planning repairs are scheduled or on every time when a pump is break down and needs to be replaced [5].

The research developed by our team was oriented mainly to create an intervention program to eliminate the disadvantages that were presented.

The predictive maintenance concept is based on the idea of including some particular sensors in the system in order to analyze the technical recorded data for establishing the right maintenance solutions when the performances of the parts starts to decrease and the chance of the process to be braked down becomes high [8].

The predictive maintenance objectives used by us are: ▪ to establish the optimum repair schedule in order to have a good maintenance

of the equipment; ▪ to prevent accidental droppings; ▪ to reduce the costs regarding maintenance; ▪ to improve the quality of the maintenance and the quality of the products [7].

The predictive maintenance tools were:

- recording of vibrations (such as the frequency, the amplitude, e.g.);
- load problems detection, such as abnormally pressures
- distinguish of the wear near limits during the process;
- analysis of the corrosion and erosion problems during equipment exploitation.

The damages are repaired in a programmed and in an organized way, avoiding severe losses to be recorded.


The parameters referring to the normal run out of the equipment (such as operating velocity, temperature, lubrication, e.g.) must be recorded in a continuous way, evaluated and

than post processed, by correctly interpreting the technical and the functional conditions whenever needed. Diagnostic techniques based on the vibrations analysis, spectroscopy, sonic analyze, e.g. can also be used. Damages will be solved in the next period by replacing only those parts that presents deviations from normal behavior, leading finally to significant supplementary costs in order to make repairs and for the maintenance of the equipment.

## 2. CASE STUDY: THE BLACK LYE PUMP OF REGENERATION BOILER

The practical research was made at S.C. SOMES Dej Company for a paper manufacturing aggregate and we study the black lye pump of regeneration boiler.

The utilized aggregate is composed by the following components, Figure1:

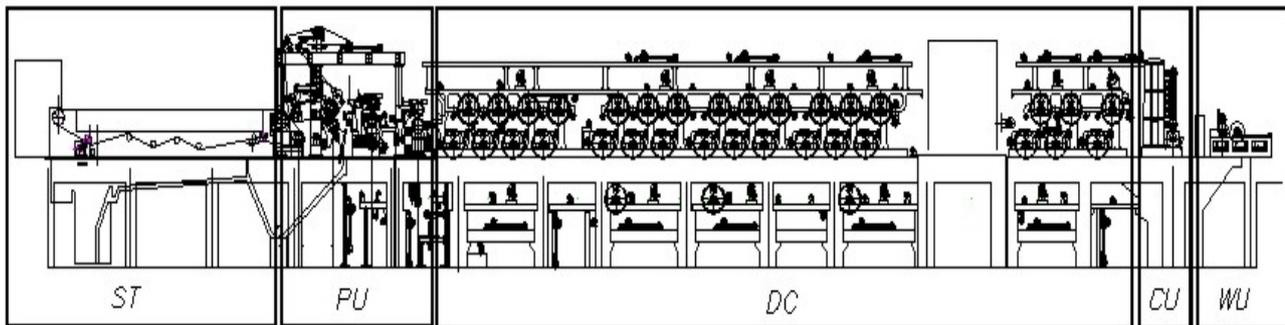

ST - the table of the sieve; PU - press unit; DC - drying cylinders; CU – calender unit; WU – wrapping unit

Fig.1. The basic scheme of the paper aggregate

- The raw material (the cellulose fiber + water + bounding agent + coloring agent+ filling materials) launched on the sieve and in the unit ST where the paper is formed as sheets and a big part of the water is being removed.

- The sequel in the press unit PU, for pressing the sheet paper, in order to remove the remaining water. (For this purpose the paper sheet is passing through the drying cylinders that are heated with steam).

- The calender unit CU that presses the paper in order to obtain a good gloss.

- The roller that ends the manufacturing process of the paper and the wrapping unit WU.

In order to identify and efficiently avoid the process interruptions, a rigorous investigation analysis is needed.

The traces, which are referring to an improper work out, are: ▪ the presence of the oil flows or the consistent grease present on the base plate, ▪ increased temperature of the engine box, ▪ the presence of an important quantity of rubber dust under the electric coupling, ▪ the misalignments between the electric engine and the pump, etc.

The predictive maintenance procedure is based on a detailed analyze of each damage in order to establish exactly what caused the problem. Meantime some changes are needed to be making out in order to prevent the future damages repeatability.

Sometime none of the demarches presented above indicates the existence of a problem, but in most cases, if multiple investigations are made, the source of the defects could be

discovered in time and could be used in order to avoid similar defects in the future. Even the time needed for the investigations seems sometimes too long, in the final, it could be concluded that the time dedicated for this purpose was not lost.

The practical researcher made by our team at S.C. SOMES Dej Company, revealed the fact that in most cases the pumps are working in improper conditions, leading to unexpected interruptions. The production of this company is over 20.000 tons of paper and over 25.000 tons of cellulose [4].

The regeneration boiler is a continuous feed with concentrated lye pump type ABS NB-125-100, driven by 22 kW/1500 rot/min electric engine.

By analyzing the historic of the black lye pump, the total duration of the unexpected breakdowns was 280 hours and the main causes were identified, as presented below:

- pump bearing deterioration - 54%;
- the burning of the electric engine, because of the excess load, caused by the restriction of the pump tubing, according to the lye pump debit adjusted, which entered into the boiler: - 28%;
- sealing up problems caused by worm sealing destruction from the shell and the axle pump - 14%;
- the breaking of the pump hold down screw, due to the high vibrations caused by the non-adequate base of the electric engine and the pump in the base structure - 7%;
- other causes: inappropriate lubrication, breaking of the rubber blades from the couple, the disequilibrium of the rotor - 3%.

The black lye pump, illustrated in figure 2, is equipped with NU 312ECP bearing, on the rotor side, and a tow 6313NR bearing on the electric engine side [1]. The break down of the pump was caused mainly because of the deterioration of the 6313 NR bearing that is placed on the electric engine side.



Fig. 2. Black lye pump

Possible causes of the bearing deterioration were identified, as following:

- a wrong technical solution for fixing the axle of the pump on the bearings;
- a high level of vibrations caused by a wrong equilibrium of the rotor, sever misalignments, “soft foot” phenomena and high stresses of the tubes;
- sealing problems between the case of the pump and the axle of the pump, that leads to a lye penetration into the body of the pump.

By analyzing all these causes, a sample pump has been prepared.

Some amendments were made, as presented below:

- the radial roller bearing 6313 NR was replaced with two radial-axial roller bearings assembled in set from 7313 BECBP series;
- the dynamic balancing of the rotor was made for a relative velocity of 1500 rot/min;
- the soft consolidation between the case of the pump and its axle was replaced with a mechanical consolidation. For this purpose, the wear sleeve was taken out and the axle of the pump was modified in order to realize the optimal assembly of the mechanical consolidation;
- the manufacturing of the base plate of the pump has been made in one fixing direction.

Meantime we have replaced the C2 black lye pump worm sealing with a mechanical sealing. A new pump base was fixed in the structure by a casting process, proceeding with one fixing pump for mounting the shoe, then the alignment of the pump electrical engine and with the laser center device that was made, and the replacement of the manual valve from pump delivery with an automatic one.

For protecting the electrical engine from the additional load, the solution that we have found

was to assemble one frequency converter that adjusts the electrical engine velocity by the black lye capacity, barred from operator monitoring board.

As could be observed, the main cause of the unexpected break down of the manufacturing process was the pump bearing deterioration.

By analyzing the run of the black lye pump over a period of 6 months, some advantages were compared to the old version of the black lye pump, such as:

- the decreasing of the unexpected break downs caused by - the damage of the pump bearings with 80%; - the wear of the rotor and the case of the pump with 73%; - the sealing up problems of the pump with 78%; - the couple break down with 64%;
- the decreasing of the planning repairs costs with 40%;
- the decreasing of the unexpected break down manufacturing process time with 67 %.

The run period of the new black lye pump version as compared to the old version of the pump was increased from 1,5 months to 6

months and the unexpected break down have been decreased with 88%.

The costs regarding the developing of the new version of the pump and the build-assembly additional costs that were needed were amortized after a period of 4 months of black lye pump using, from the economies made with the maintenance, without taking into account the product-looses, caused by the unexpected break downs.

### 3. THE METHODOLOGY OF SUPERVISING THE EQUIPMENT'S STATE

One of the efficient supervising methods of the functioning state of the equipment is the measurement of the vibrations [3].

For this purpose, we have used the Microlog CMVA60, PRISM<sup>4</sup> software and Martin-Condition Detector device, in order to measure the period of the vibrations in the following directions: horizontal, vertical and axial.

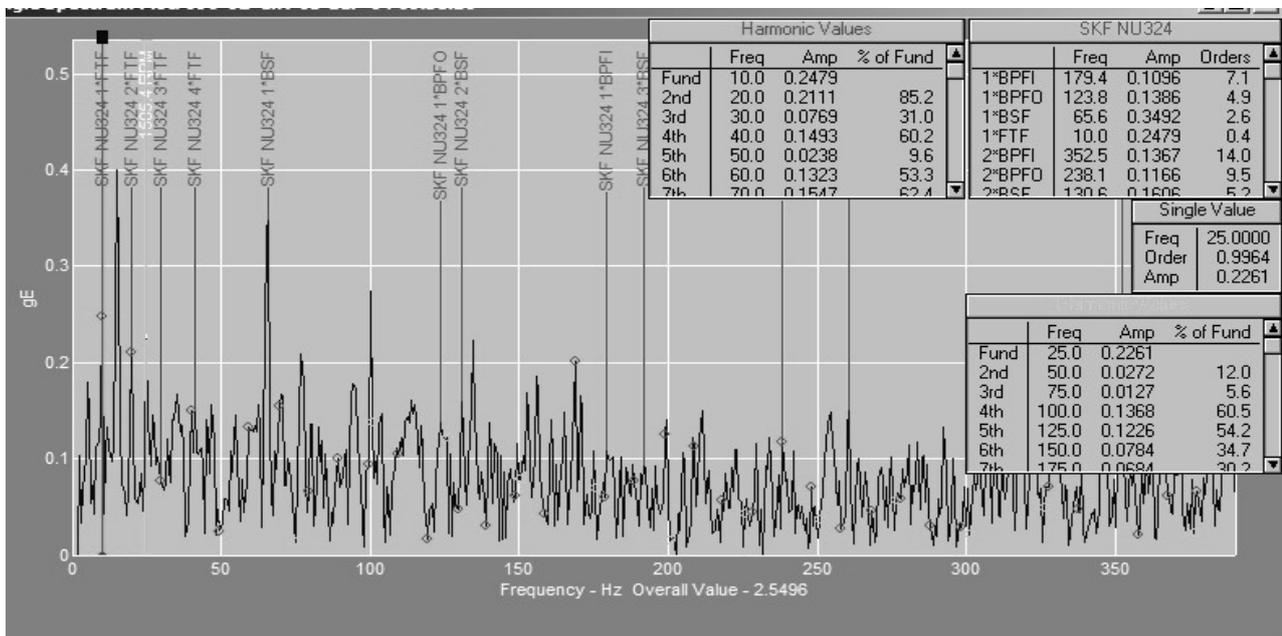


Fig. 3. The diagram of the evolution of the horizontal vibrations of the pump

In figure 3 is presented the evolution diagram of the horizontal vibrations period at one of the aggregate's pump.

As it can be observed from figure 3, the amplitudes started to be increased suddenly. After solutions that were applied, we

noticed that these amplitudes were finally brought back to the normal limits.

The results obtained in the made research revealed the fact that the unexpected break downs of the pump electric engine were caused by the damages of the electric engine

components, such as the rotor, the stator or the bearings (figure 4).

In order to find out what are the possible damages of the electric engine, a vibration detector was used in order to collect data about vibrations, which are present in the

manufacturing process during the normal run out of the engine.

The data were processed afterwards and some conclusions about the working state and possible damages of the electric engine were made.

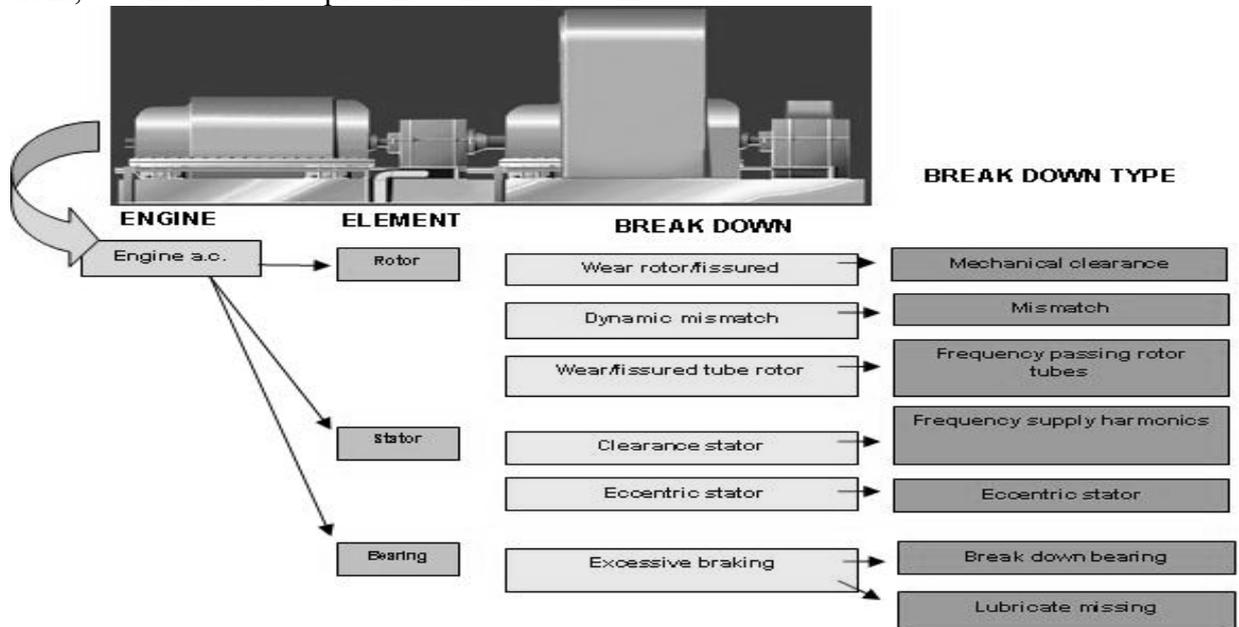


Fig. 4. Possible damages of the electric engine

Some improvements were made regarding the retrieve and replace of the engine, in order to avoid a capital break down of the engine.

The maximum vibrations are caused by the misalignments during disassembling process and not by the prominent vibrations from the electrical damages, figure 5.

The bearings damages leads to vibrations with high frequency and variable amplitudes.

As illustrated in figure 6, it is possible to observe the fact that the machine frame resonance caused by the dynamic disequilibrium has the auto-amortization tendency.

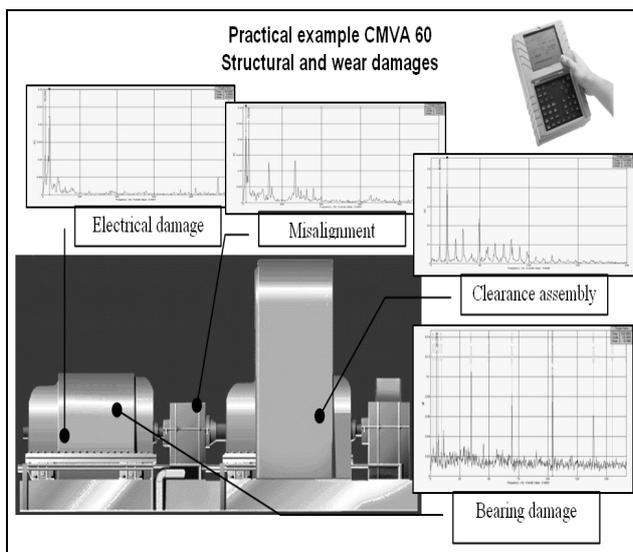


Fig. 5. Structural and wear damages

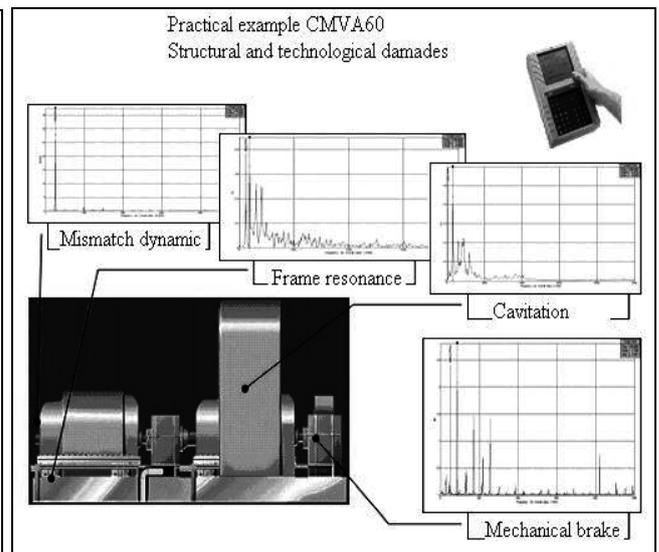


Fig. 6. Structural and technological damages

#### 4. CONCLUSIONS

In order to realize an efficient exploitation of the equipment used within the paper industry the followings solutions are necessary to be taken in consideration:

- ▶ the continuous and careful supervising of the behavior of each equipment;
- ▶ the elaboration of a maintenance program;
- ▶ the elaboration of some adequate reconditioning technologies.

By analyzing the technical state of the company, different type of equipment and by using the vibrations detector, it is possible to classify the equipment that needs to be repaired or replaced.

By applying the predictive maintenance method it is possible to record and analyze the evolution regarding the working state of the equipments and the process evolution of different types of damages in time.

Based on this remarks, it is possible finally to conclude that an efficient predictive maintenance concept that is applied (as it was made by our team) in S.C. SOMES Dej Company case study, leads to a significant decrease of the additional costs and to a significant increase of the run out capability and operational reliability of the equipment in time.

## 5. REFERENCES

- [1] Costea A., Ros O., Gyenge Cs. *Some Aspects Regarding The Application Of The Predictive Maintenance Procedure For Paper Industry*, Proceedings of The 14<sup>th</sup> International Conference - Modern Technologies, Quality and Innovation - New face of TMCR ModTech, pag. 235-238, ISSN-2066-3919, Slanic Moldova, 2010.
- [2] Gramescu, T., Chirila V. *Calitatea si fiabilitatea produselor*, ISBN 9975-63-100-2, Publisher Tehnica-Info, Chisinau, 2001.
- [3] Gyenge Cs., Ros O., Costea A. *Researches regarding the risk based maintenance of equipments for paper and pulp industry*. International Conference on Manufacturing and Education – MSE, pp.245-246, ISSN 1843-2522, Sibiu, 2007.
- [4] Gyenge, Cs., Ros, O., Fulop, I., Itu, C., Todea, M.; Costea, A. *Some characteristic aspects of recycling the huge aggregate from paper industr.* The 17<sup>th</sup> International DAAAM Symposium, pp.153-154, ISBN 3-901509-57-7, Viena, 2006.
- [5] Kovasc, G., Kopacsi, S., Haidegger, G., Nacs, J. *Role of maintenance in life-cycle engineering*. Jurnal of machine manufacturing – Design and Manufacturing, pp. 15-23, ISSN 0016-8580, EuroCenter Obuda, Budapest, 2009.
- [6] Ionut, B., Rus, I., Ionut, V., Stirbei, I., Moldovanu, G. *Mentenanata, Mentenabilitate, Tribologie si Fiabilitate*, ISBN 973350479, Publisher Sincron, Cluj-Napoca, 2003.
- [7] RIMAP. FP6 -Project - *Risk Based Inspection and Maintenance Procedures for European industry*, 2004.
- [8] *Guide to risk assessment requirements*. HSE Books, ISBN 0717615650, San Diego, 1996.

### Cercetări experimentale privind aplicarea mentenanței predictive în industria hârtiei

**Rezumat:** În lucrare se prezintă un studiu de caz privind implementarea sistemului de mentenanță predictivă, în cadrul industriei de hârtie. Analizând conceptul de mentenanță predictivă se prezintă avantajele aceluia utilizând un studiu de caz. Lucrarea prezintă aplicarea conceptului de mentenanță predictivă în cadrul firmei SC Someș SA Dej, pentru pompa de leșie neagră a cazanului de regenerare. Analizând cauzele defecțiunilor echipamentului se elaborează procedura de reparare, care urmărește metodologia mentenanței predictive. Cu scopul de a cunoaște defecțiunile echipamentelor, se utilizează un aparat de măsurare a vibrațiilor, iar astfel analizând datele înregistrate se stabilesc soluțiile necesare în vederea evitării apariției defecțiunilor.

**Ancuta Pacurar**, Dr. Eng., Teaching Assistant, Technical University of Cluj-Napoca, Department of Manufacturing Engineering, B-dul Muncii, no.103-105, 400641, Cluj-Napoca, [ancuta.costea@tem.utcluj.ro](mailto:ancuta.costea@tem.utcluj.ro), 0040-264-401721.

**Csaba Gyenge**, Dr.h.c.eng., Professor, Technical University of Cluj-Napoca, Department of Manufacturing Engineering, B-dul Muncii, no.103-105, 400641, Cluj-Napoca, [gyenge\\_cs@yahoo.com](mailto:gyenge_cs@yahoo.com), 0040-264-401721.

**Annamaria Rafa**, Drd.Eng., Ph.D. Student, Technical University of Cluj-Napoca, Department of Manufacturing Engineering, B-dul Muncii, no.103-105, 400641, Cluj-Napoca, [annamariarafa@yahoo.com](mailto:annamariarafa@yahoo.com), 0040-264-401721.